

1

2

3

4

5

A

B

C


D

A

B

C

D

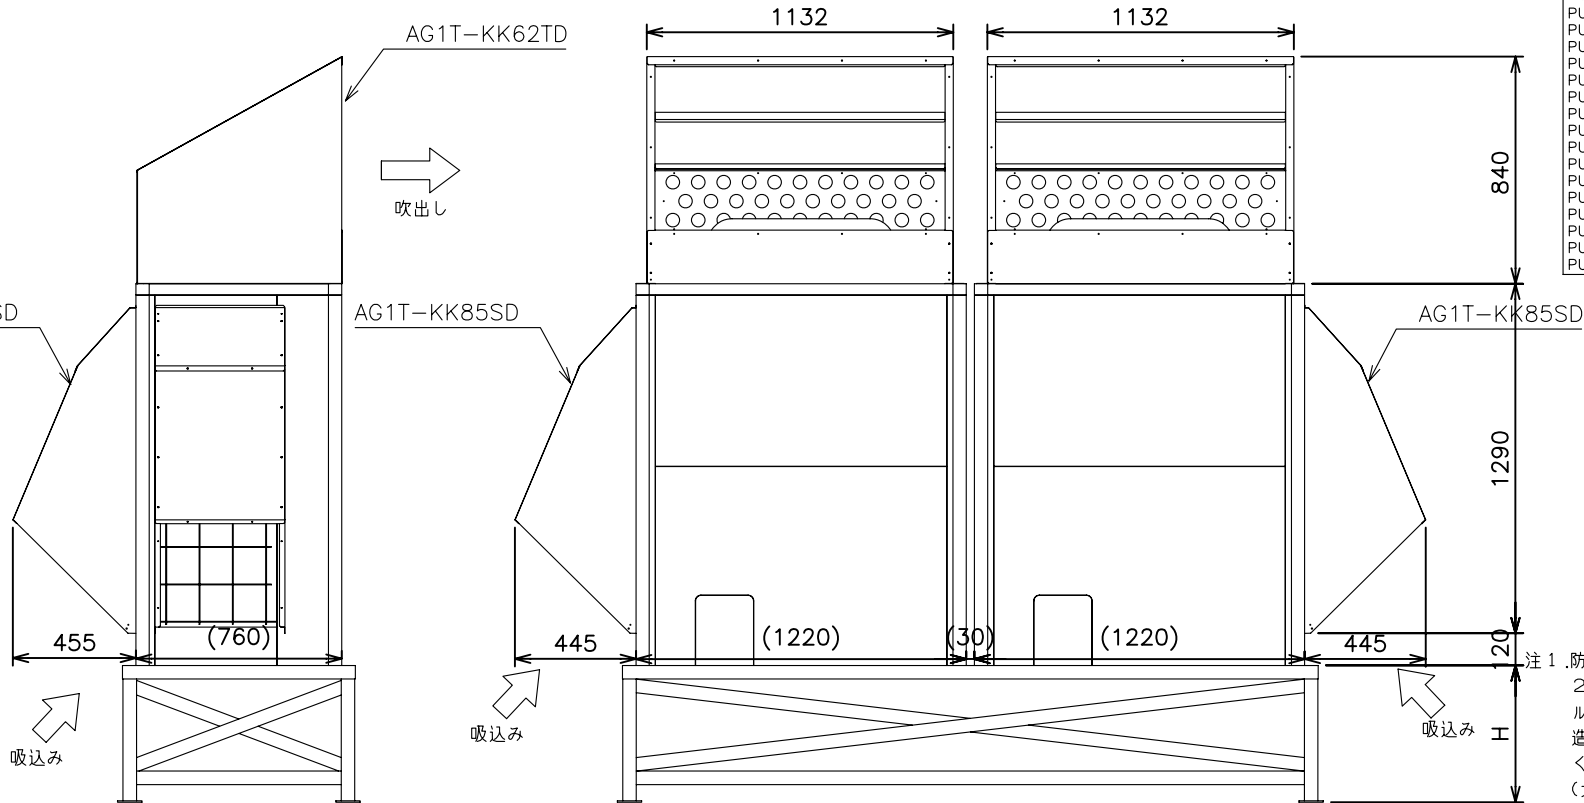

E	
室外ユニット形名	
PUHY-P960CM-E1	PURY-EP560SCM-G
PUHY-P1010CM-E1	PURY-EP630SCM-G
PURY-P850SCM-E(1)	PURY-EP690SCM-G
PURY-P900SCM-E(1)	PURY-EP730SCM-G
PUHY-P960SCM-E2	PURY-P850SCM-G
PUHY-P1010SCM-E2	PURY-P900SCM-G
PURY-EP560SCM-E	PURY-RP450SCM-G
PURY-EP630SCM-E	PURY-RP500SCM-G
PURY-EP690SCM-E	PURY-RP560SCM-G
PURY-EP730SCM-E	PURY-RP630SCM-G
PUHY-EP630SCM-E3	PURY-RP690SCM-G
PURY-RP450SCM-E3	PURY-RP730SCM-G
PURY-RP500SCM-E3	PURY-RP800SCM-G
PURY-RP560SCM-E3	PURY-RP850SCM-G
PURY-RP630SCM-E3	
PURY-RP690SCM-E3	
PURY-RP730SCM-E3	
PURY-RP800SCM-E3	
PURY-RP850SCM-E3	

形名	材質	表面色	重量	備考
AG1T-KK62TD(フード部のみ)	鋼板 t1.0	マンセル5Y8/1	47.2kg	PAC-KK76TD(2台使用)と互換
AG1T-KK85SD(フード部のみ)	鋼板 t1.0	マンセル5Y8/1	19.9kg	PAC-KK85SDと互換
AG1T-KK72SD(フード部のみ)	鋼板 t1.0	マンセル5Y8/1	29.4kg	PAC-KK87SD(2台使用)と互換


- 注1. 防雪架台の高さHは、予想される積雪量の2倍程度として下さい。又、架台はアングル鋼材等で組み立て、風雪の素通りする構造とし架台の幅はユニットの寸法より大きくならないよう決定して下さい。
(大きすぎると、その上に積雪します)
2. ユニット設置時、季節風が吹出口、吸込口の正面から当たらないように考慮して下さい。又、シュートサイクルにならないように十分なスペースを確保して下さい。
3. 屋根から雪が落ちる場所への設置はさけて下さい。又、雪下ろしは早めを実施して下さい。
4. 本図を参考として、現地に架台の製作、施工を実施して下さい。

改定CHANGE

適用室外ユニット形名追加により改定
'07-11-28 岩村 梶村適用室外ユニット形名追加により改定
'08-11-15 岩村 梶村適用室外ユニット形名追加により改定
'09-11-14 岩村 梶村適用室外ユニット形名追加により改定
'10-2-12 岩村 梶村適用室外ユニット形名追加及びタイトル表記変更のため改定
'11-9-1 郡司 梶村

出図先()

控 1



DIM.IN mm

尺度 SCALE

:

NTS

三菱電機システムサービス株式会社

作成日付
DATE '07-9-6作成
DRAWN 矢野照査
CHECKED 岩村設計
DESIGNED 岩村検認
APPROVED

梶村

TITLE

AG1T-KK62TSD
防雪フード組込図

DWG.No.

X903703M00277